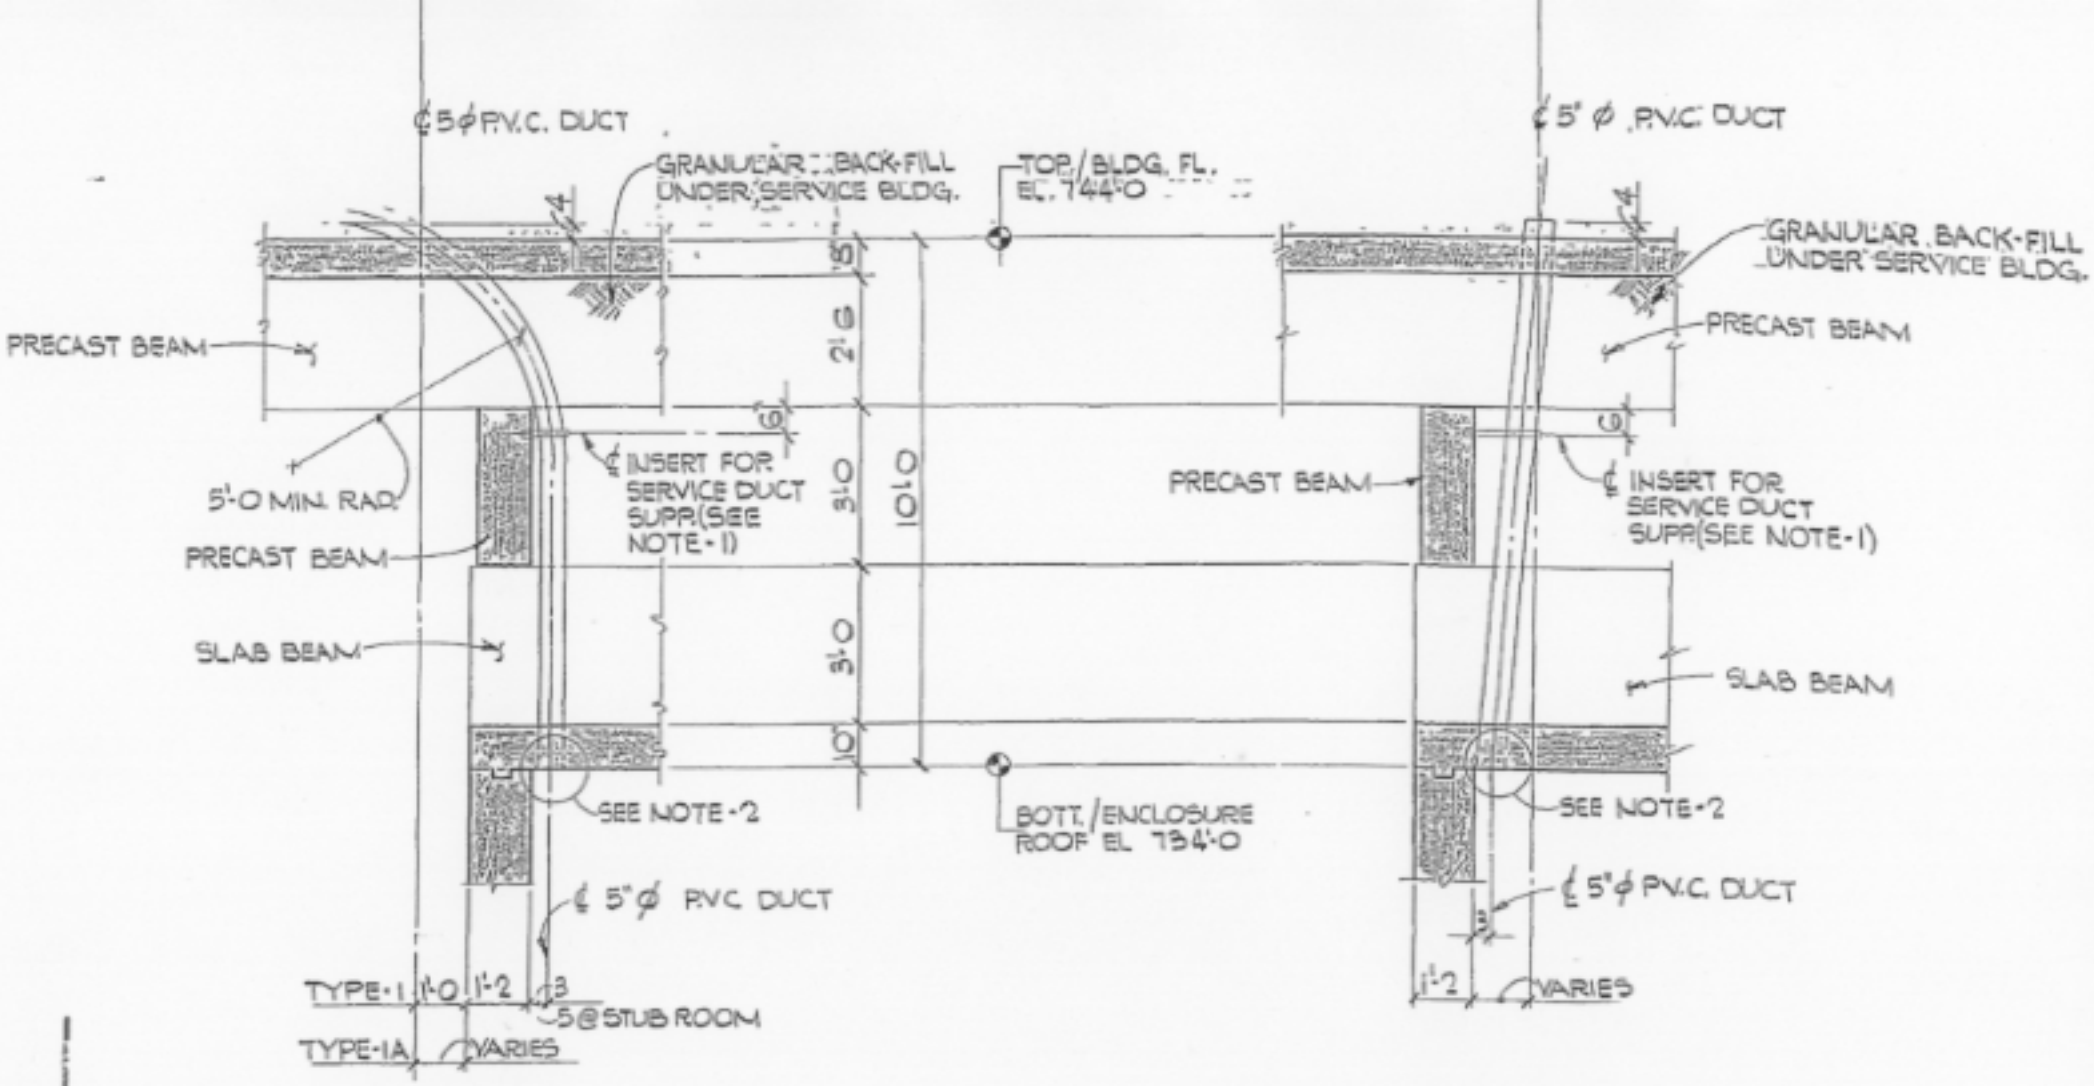

ELEV. 734'-0

TYPE-1

TYPE-1A

TYPE-2

NOTES:

1. SERVICE DUCTS ARE TO BE SUPPORTED IN SUCH A MANNER THAT THEY ARE NOT DAMAGED OR MOVED DURING BACKFILL OPERATION.
2. SEE SPEC. FOR BELL END DUCT TERMINATOR.

Attachment 9
1 of 2

REFLECTIVE ENCLOSURE CEILING P

SCALE 1/8" = 1'-0

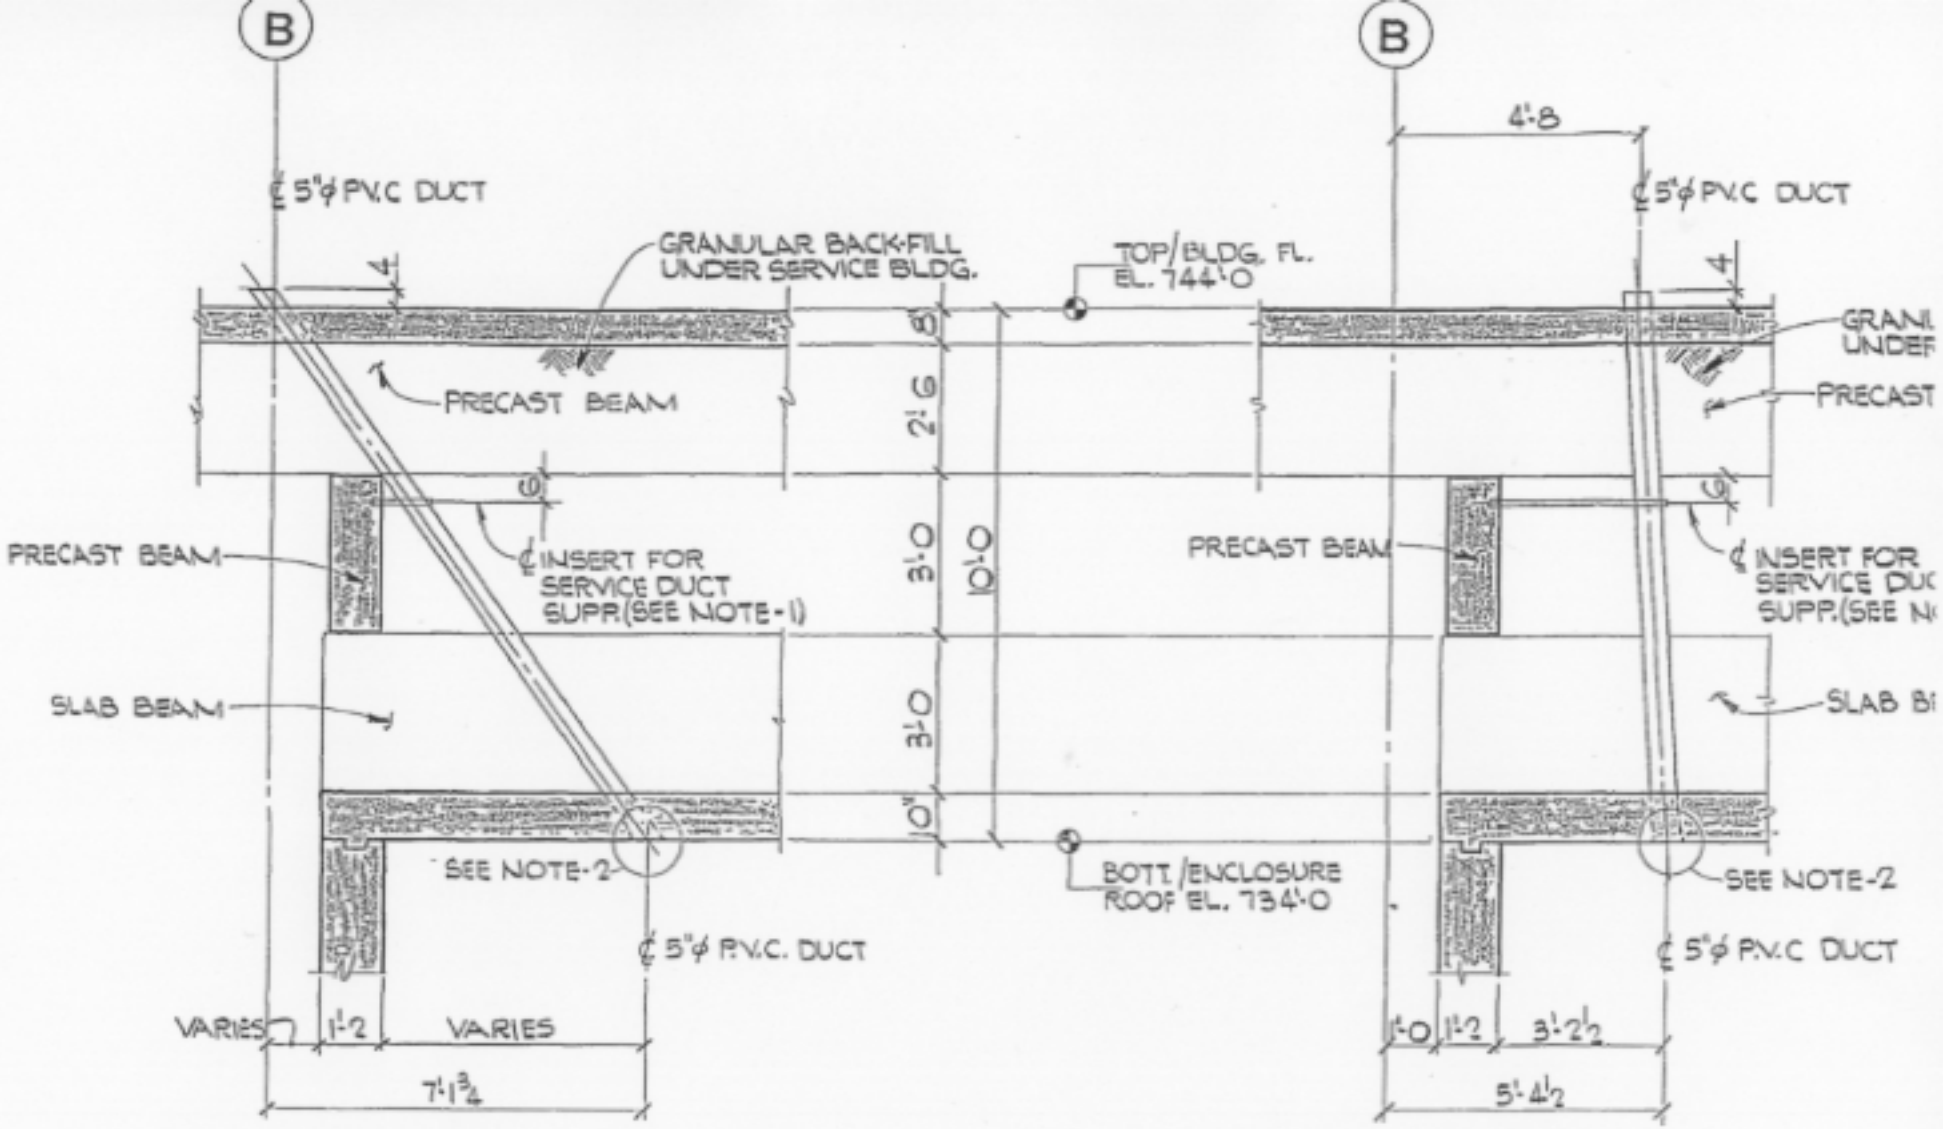

TYPE-3

TYPE-4

Attachment 9
2 of 2

TYPICAL SERVICE DUCT DETAILS